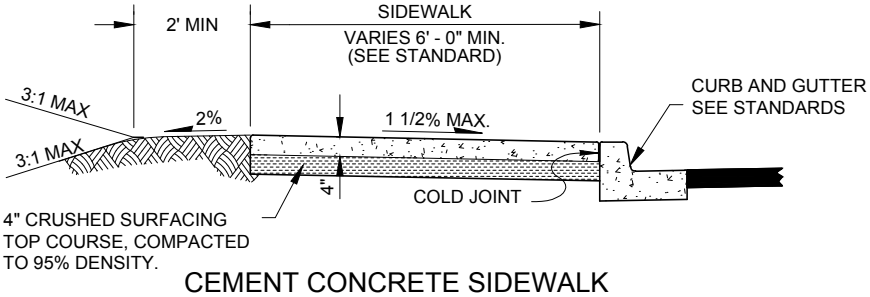

CEMENT CONCRETE SIDEWALK
ADJACENT TO CURB



(C) CONTRACTION JOINT

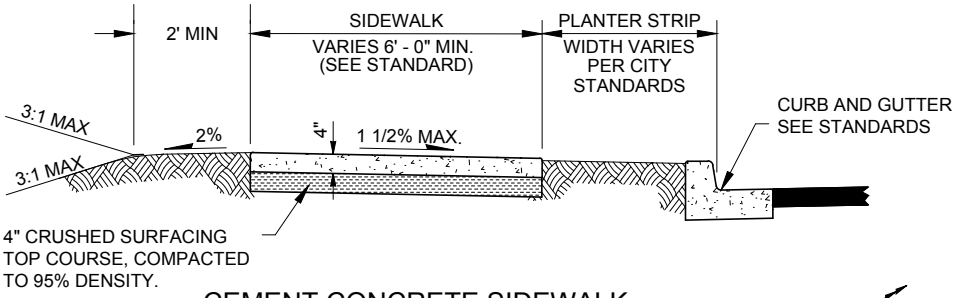

CEMENT CONCRETE SIDEWALK
ADJACENT TO PLANTER STRIP



(E) EXPANSION JOINT

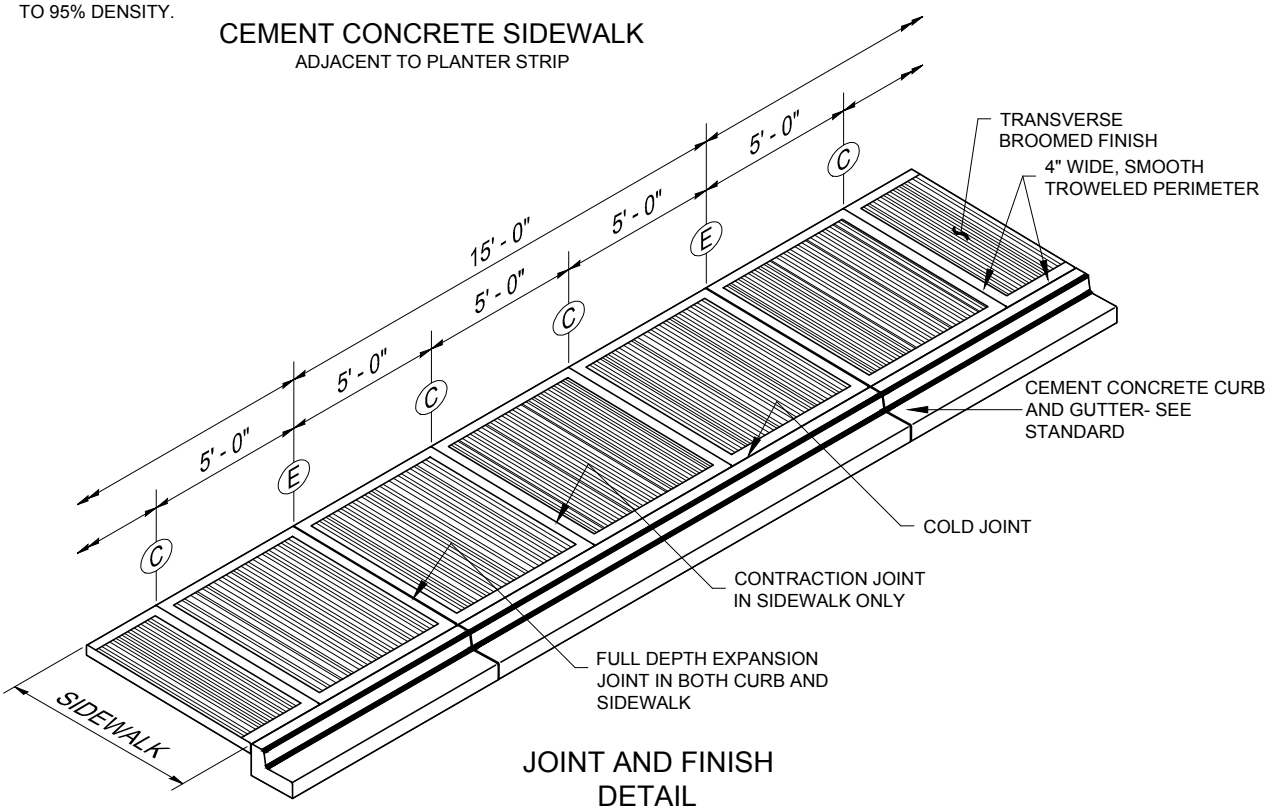

JOINT AND FINISH
DETAIL

NOTES:

1. SIDEWALKS THROUGH CONCRETE DRIVEWAYS SHALL BE 6" THICK.
2. SIDEWALKS SHALL BE CLASS 3000 CEMENT CONCRETE.
   MINIMUM SIDEWALK WIDTH IS 5.0'.
3. SEE STANDARD DRAWING 3102 FOR SPECIFIC SIDEWALK REQUIREMENTS IN DOWNTOWN ZONE.
4. FORM AND SUBGRADE INSPECTION IS REQUIRED BEFORE PLACING CONCRETE.
5. CONCRETE SIDEWALKS SHALL BE CURED FOR 72 HRS. MIN.

City of Bremerton **PUBLIC WORKS** **ENGINEERING DIVISION**		CONCRETE SIDEWALK DETAIL NON-DOWNTOWN LOCATIONS Alteration of this drawing is prohibited. Any approval of an altered drawing is unauthorized and void.	3101 Revision Date 3/3/16